


Installation of Leisure Line Hot Air Jacket




1. A qualified person must perform all work
2. Install Coal Stoker output into cold air Return of existing hot air furnace
3. Ensure that hot air jacket absorbs as much Heat as possible
4. Ensure that a fan limit is used to control Existing hot air furnace fan
5. Wire the fan limit into the AC side of Existing hot air furnace fan controls
6. Ensure that the existing hot air furnace Is never subjected to a temperature higher than allowed by the manufacturer.
7. These instructions are general guidelines Only, please consult an HVAC Professional before attempting work
8. Contact your dealer if there are any questions

NOTE: Dimension shown for width and Outlet size is for Hyfire Pocono is 27 ½" wide with 12" std. Outlet.

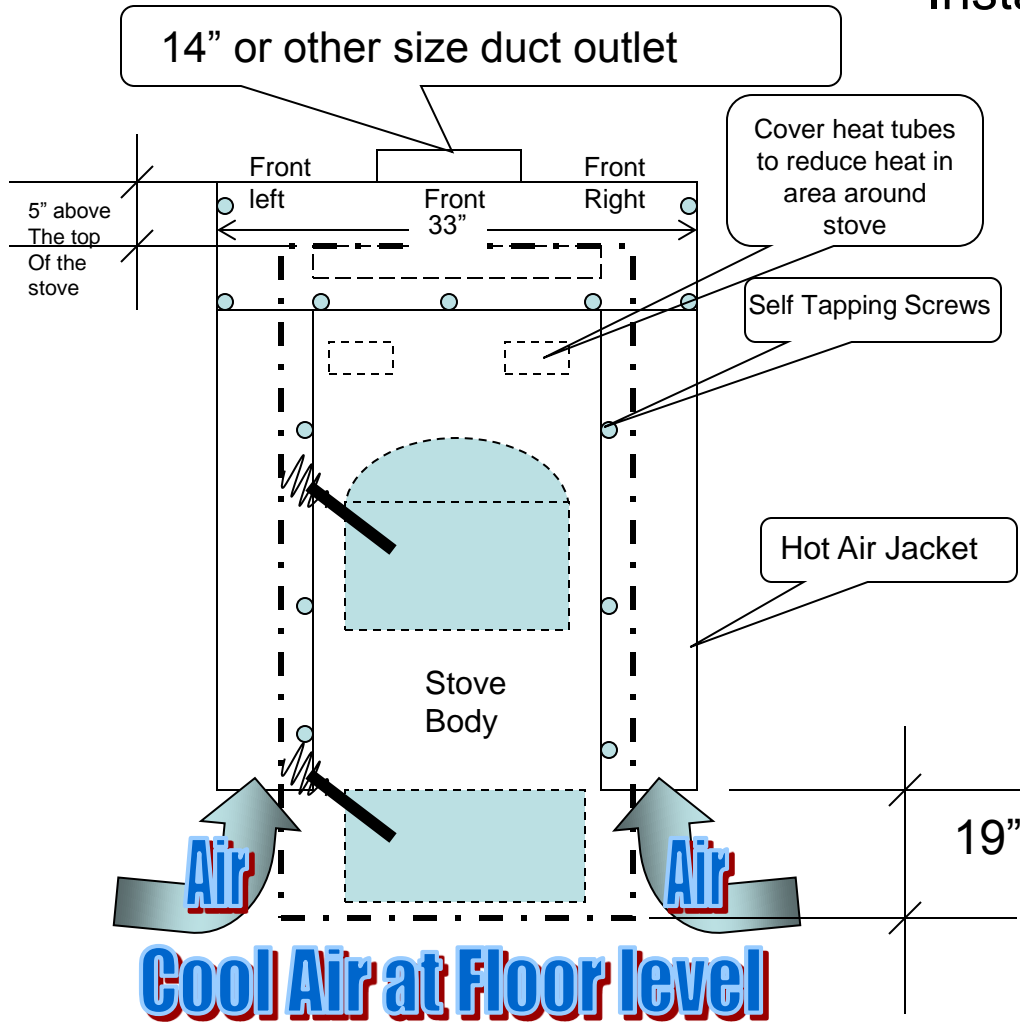


Div. of Black Rock Mfg. Co.

Configuration 1 with no inline duct fan, 265 CFM fans can be installed Or not

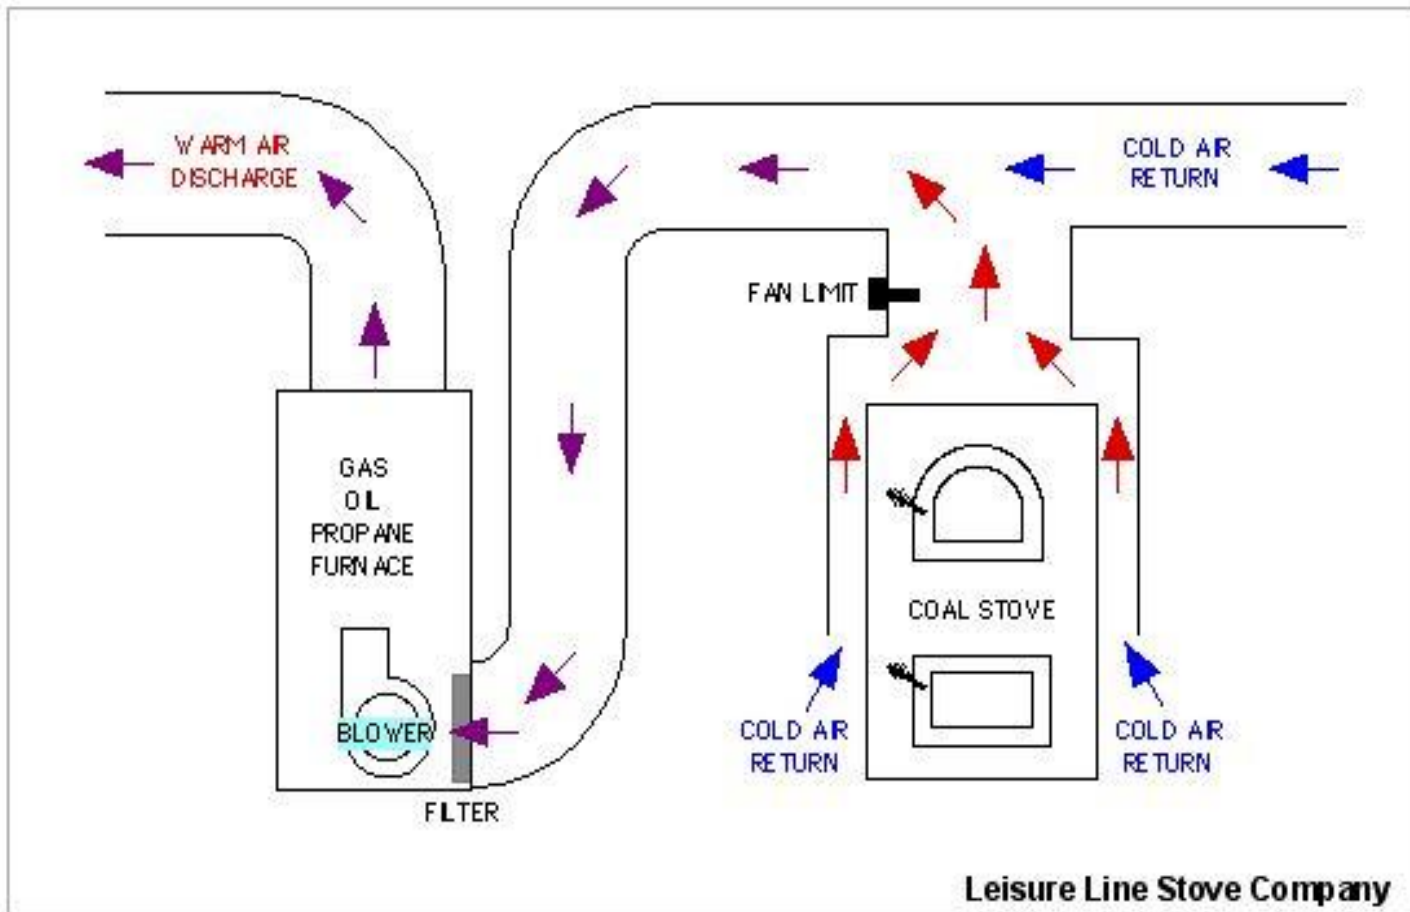

Caution: This sketch does not replace advice from an HVAC Professional, please ensure your installation is checked by a qualified individual.

Configuration 2, with inline duct fan and limit switch

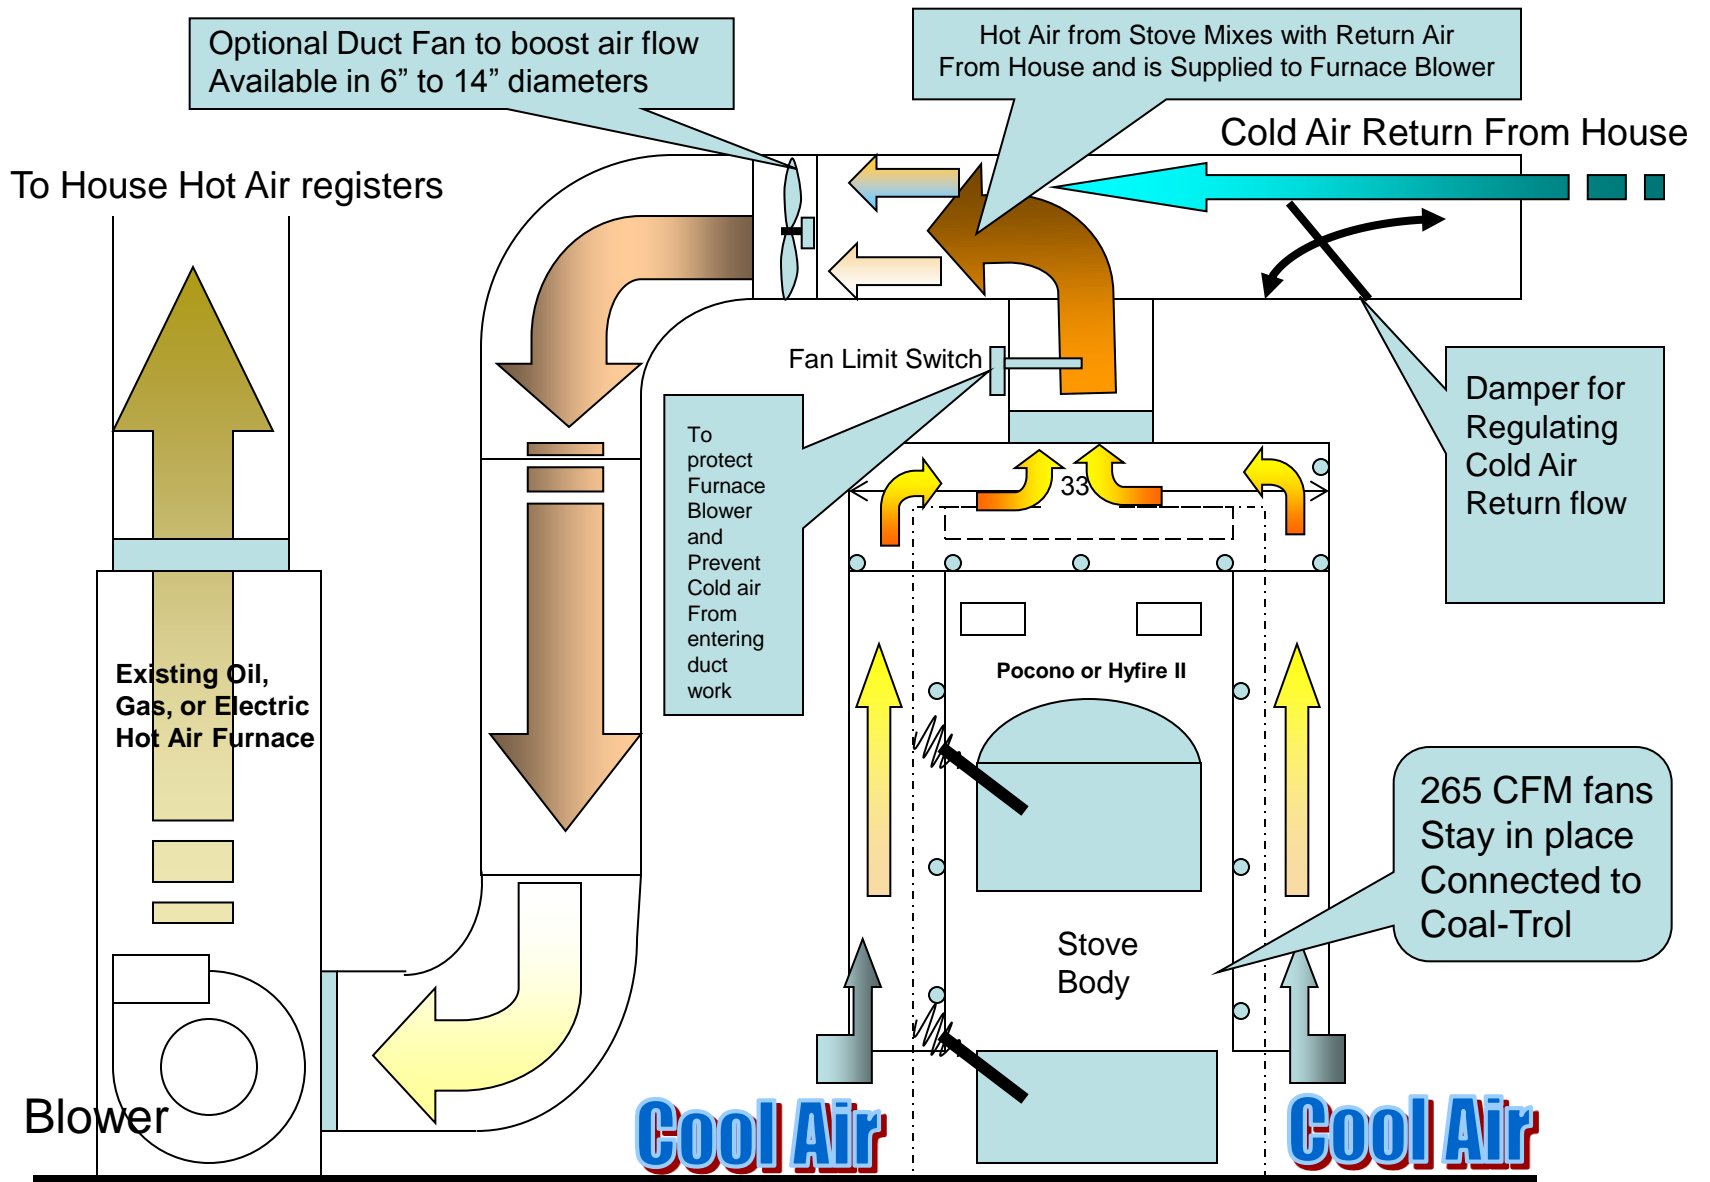

Caution: This sketch does not replace advice from an HVAC Professional, please ensure your installation is checked by a qualified individual.